

Disabled Refuge, Evacuation & Toilet Alarm Systems

BS5588 Part 8
and NHS FPN3
Compliant



BS5588 Part 8 states:


“The two-way communication system needs to be readily operated by, and comprehensible to, disabled people.”

It further states:

“... the essential requirement for independent communication between the occupants [of the refuges] and evacuation management personnel needs to be met.”

- Desk, wall or console mounted Master Station
- Master Station displays identity of the calling refuge station
- Vandal resistant lobby and refuge stations
- Available in Stainless Steel as standard, Brass or Bronze to order if required
- Disabled Toilets with reset switch and / or ceiling mounted pull cord.
- Local Reset facility available to ensure attendance at refuge locations
- Stand-by Power Supply (UPS) supports system for up to 6 hours
- System activation using keyswitch or PIN code
- All activated calls are registered at master station, even if all refuge stations call at once
- Operator can scroll through queue to answer or operate on a first in first out basis
- Very high quality speech
- Simple cabling: just one CAT-5 cable per station
- Monitoring of cables for short & open circuits
- Multiple master stations if required
- **Options**
 - Acoustic monitoring / or loudspeaker and microphone failure
 - Tamper Alarm
 - Integral Camera
 - Connection to ILA (Induction Loop Amplifier)

**GE200 / 700
Central Unit**

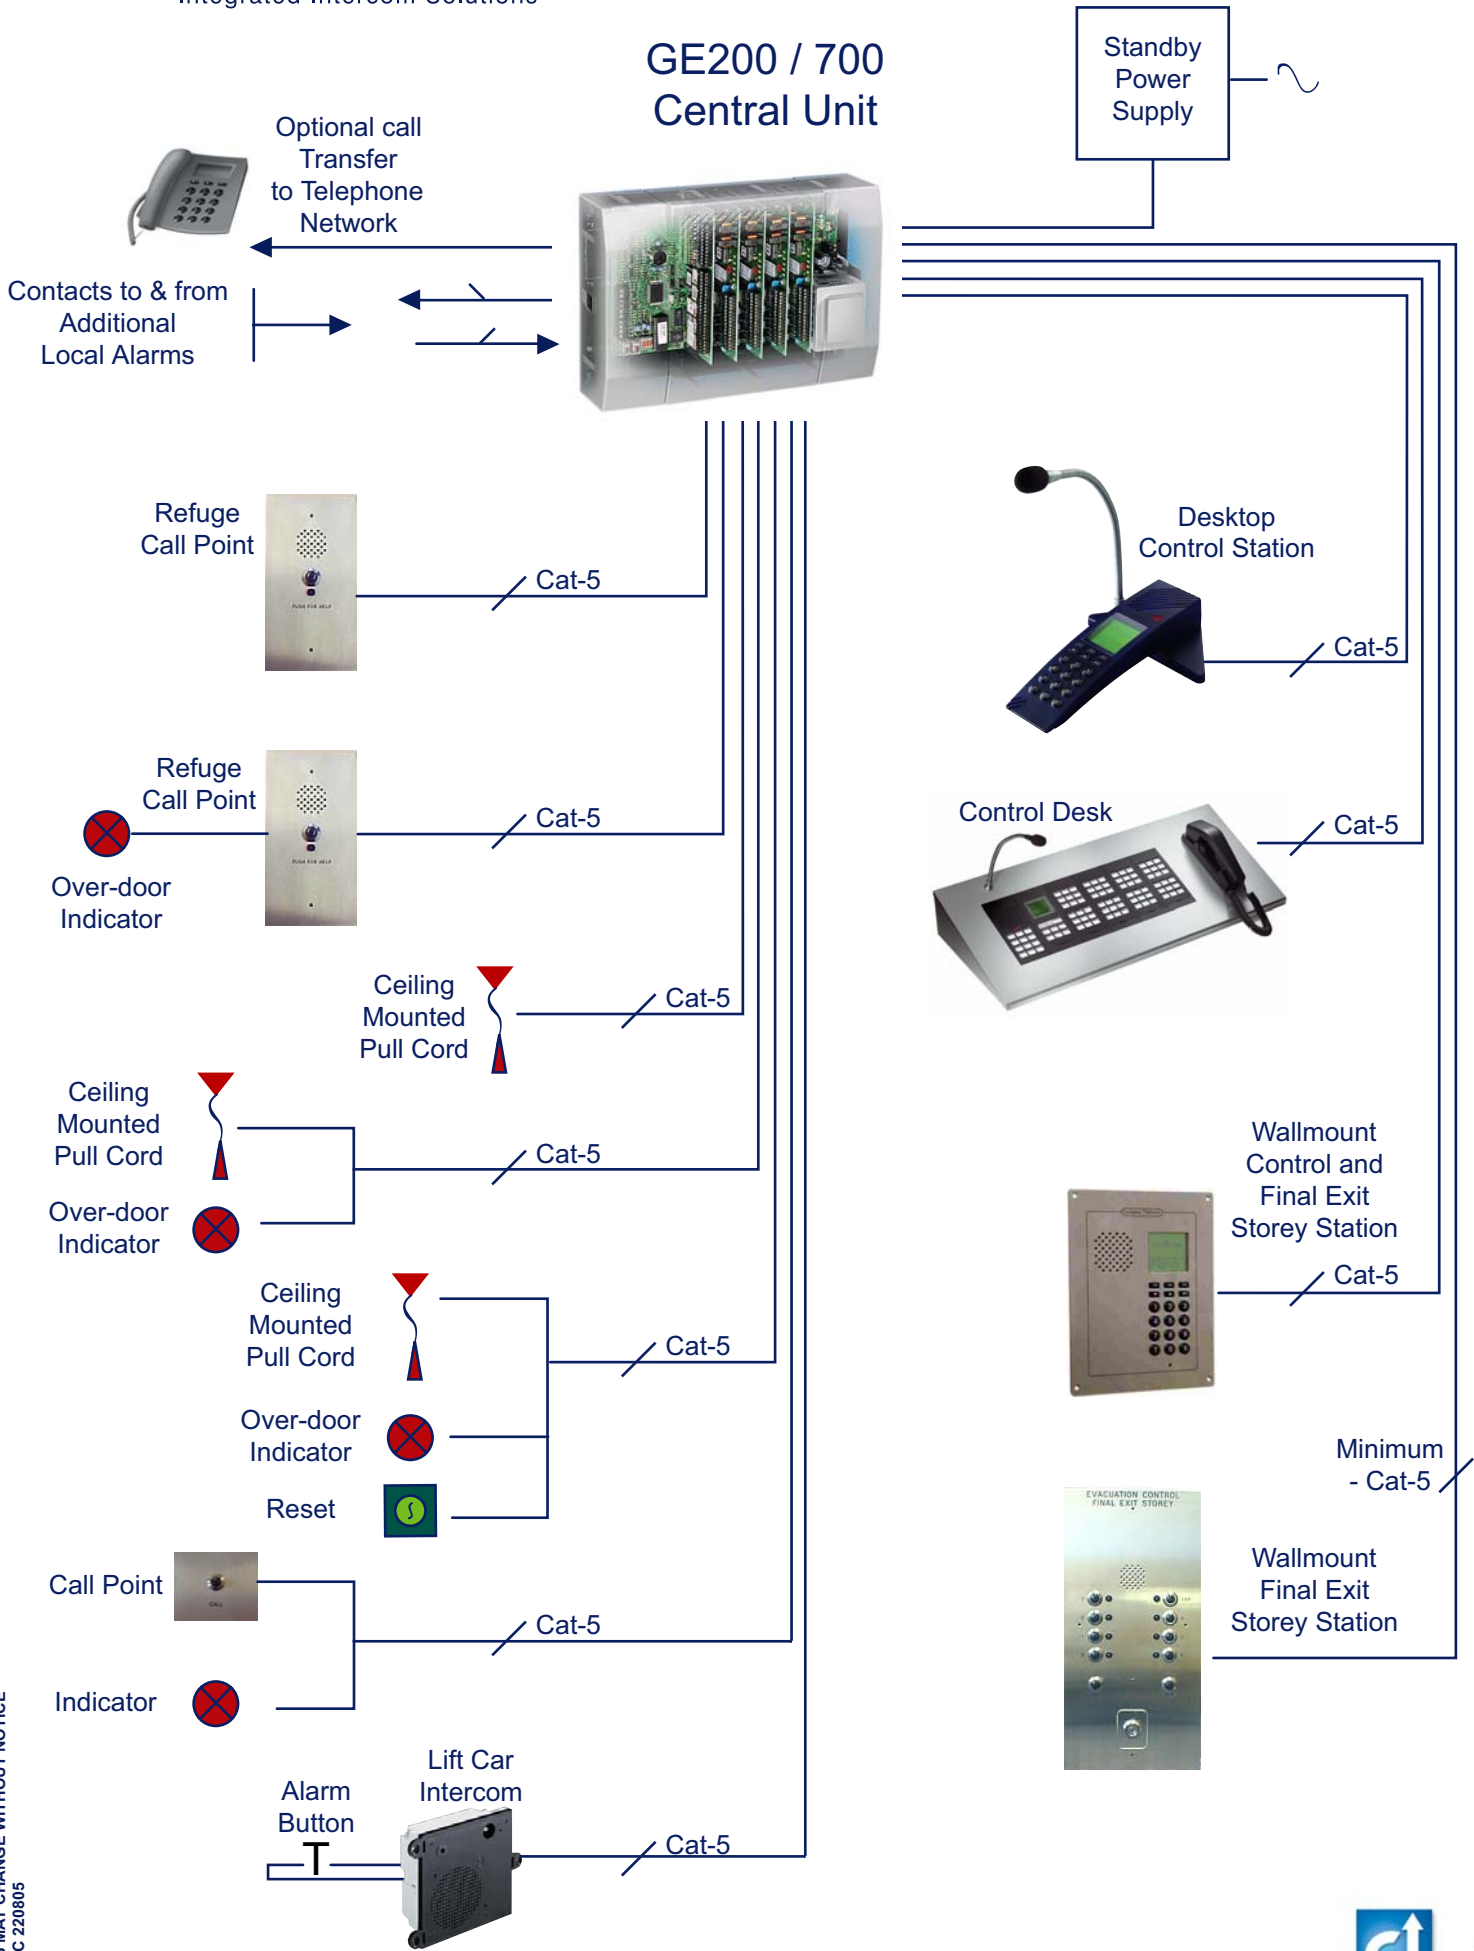

SPECIFICATIONS MAY CHANGE WITHOUT NOTICE
DIS_REF_N_EVAC 220805